


**All commercial projects shall require an approved RP Device.**

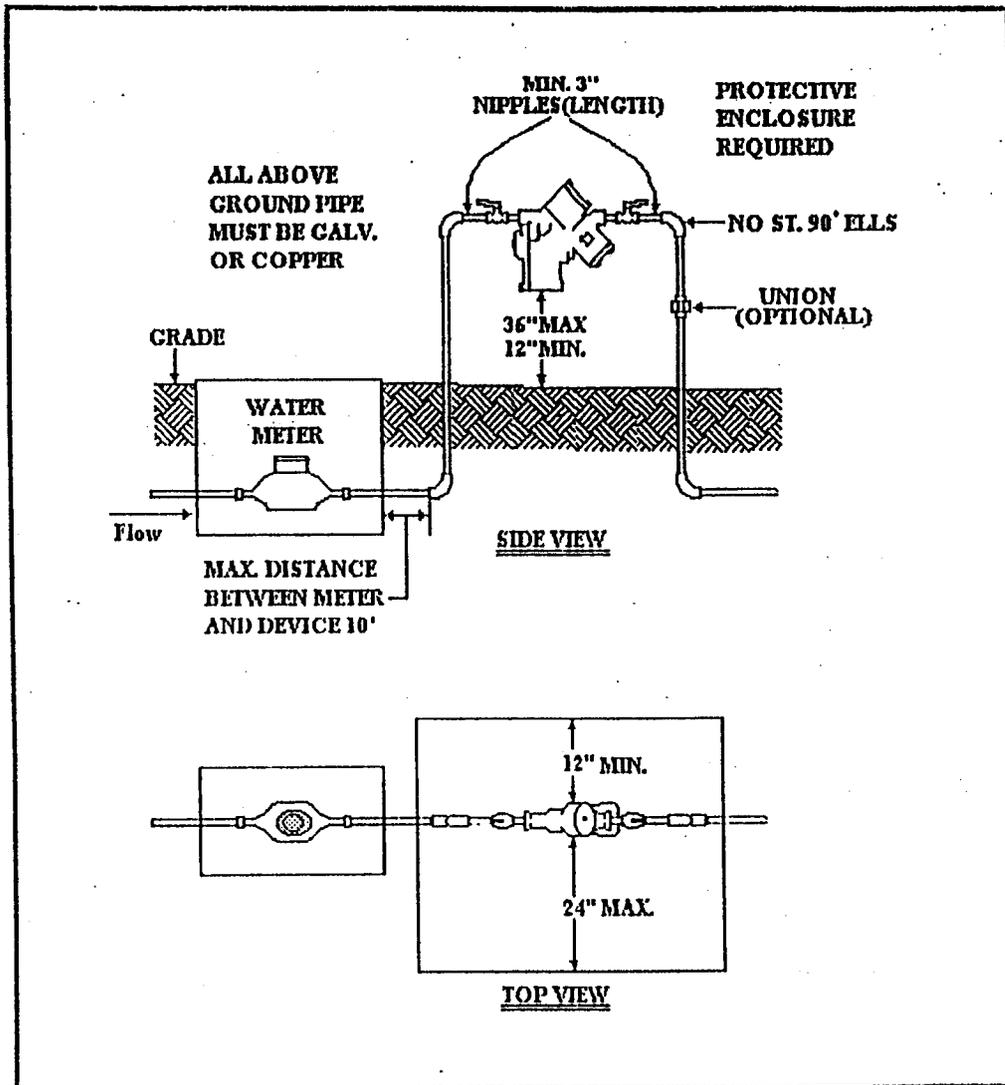

**I. Installation Requirements**

- A. All devices must be approved RP devices.  
(Wilkins 975, Febco 825Y or approved equal)
- B. City water meter and approved backflow prevention assembly must be of the same size.
- C. Distance between water meter and approved backflow prevention assembly shall not exceed ten feet.
- D. Valves, tees, connections or flow restrictions of any type between the water meter and the approved backflow prevention assembly shall be prohibited.
- E. No Wye Strainers before the # 2 shut-off valve.
- F. Any deviation from the methods described above must receive cross-connection inspector approval prior to installation.